



EPA NORTHERN DIRECTORATE, ABBOTTABAD,
Forestry, Environment & Wildlife Department
Govt. of Khyber Pakhtunkhwa

No. EPA/ND/ATD/IEE/CP

4621-24

Dated: 01/06/2018



SCHEDULE-V

Decision on IEE

1. **Name, address of proponent:** Mr. Yasir Khan
Owner of crush plant, Village & Post Office
Kakul, Tehsil & District Abbottabad
Contact No. 0314-5002329
2. **Description of project:** The project is proposed to establish near village Bhajwala, Tehsil & District Haripur. Total Capacity of the project is Capacity is 10,000sf/d. During operational phase the total water consumption of the plant is about 15 m³/day which will be met from boring water and rain water. The construction and operational Phase of the project will require power which will be supplied by Water and Power Development Authority (WAPDA). A transformer of 200KV will be installed to meet the energy requirement. About 10-12 labors and Technicians will work during construction phase, whereas 8-10 staff will work for the operation of the project.
3. **Location of the project:** The project is located near Village Bhajwala, Tehsil & District Haripur. (GPS N: 33.9547766 E: 72.0722691)
4. **Date of filling of IEE:** 19/03/2017
EPA, Northern Directorate (Dairy No. 3093)
5. After careful review of IEE report and field visit report carried out by Mr. Shoaib Ahmed (Training Officer) on 26-03-2018, the Environmental Protection Agency, Northern Directorate, Abbottabad, Govt. of Khyber Pakhtunkhwa has decided to accord approval of the Initial Environmental Examination of Yasir Khan stone crush plant, near Village Bhajwala District Haripur of Khyber Pakhtunkhwa in line with the guidelines issued by Pak. EPA and IEE/EIA Regulations, 2000 subject to the following terms & conditions:
 - a) The proponent will adopt all precautionary and mitigation measures identified in IEE report as well as any unanticipated impacts during the construction and operation phase of project.

Amill 01/06/2018



**EPA NORTHERN DIRECTORATE, ABBOTTABAD,
Forestry, Environment & Wildlife Department
Govt. of Khyber Pakhtunkhwa**

4621-24


No.EPA/ND/ATD/IEE/CP

Dated: 01/06/2018



(b) The proposed crush plant must be constructed "According to the recommendation of the Sub Committee, the safe distance for stone crushers will be 500 meters from human dwellings in urban areas and 300 meters in rural areas, whereas 200 meters from road. The definition of human dwellings/hamlet shall be considered a cluster of at least 50 houses. These shall be implemented by Industry department as per provision of Rule 3 of Powers Crushers (Installation, Operation and Registration) 1998".

- (c) Employment should be provided to local people particularly for unskilled jobs.
- (d) Carry sprays twice a day i.e 7:00 am and 1:00 pm on non metal roads during construction and operation phase in order to minimize dust during delivery.
- (e) The proponent should cover the delivery vehicles properly.
- (f) Health Safety equipments (mask, helmet, glasses, gloves, shoes, air plugs, etc) should be provided to the workers.
- (g) Plantation (i.e. Chinar =100, Walnut=100, Pines=100) in open available space should be carried out as per plantation plan submitted to this Agency after issuance of NOC. Plantation must be completed before the operational of the plant.
- (h) Water spray should be carried out on material through a water pump connected with pipelines and water spraying nozzles.
- (i) The proponent will install Air/Dust Control System as per SOPs of stone crush plant: Specification and drawing of Dust/Air Pollution Control System is given as below):

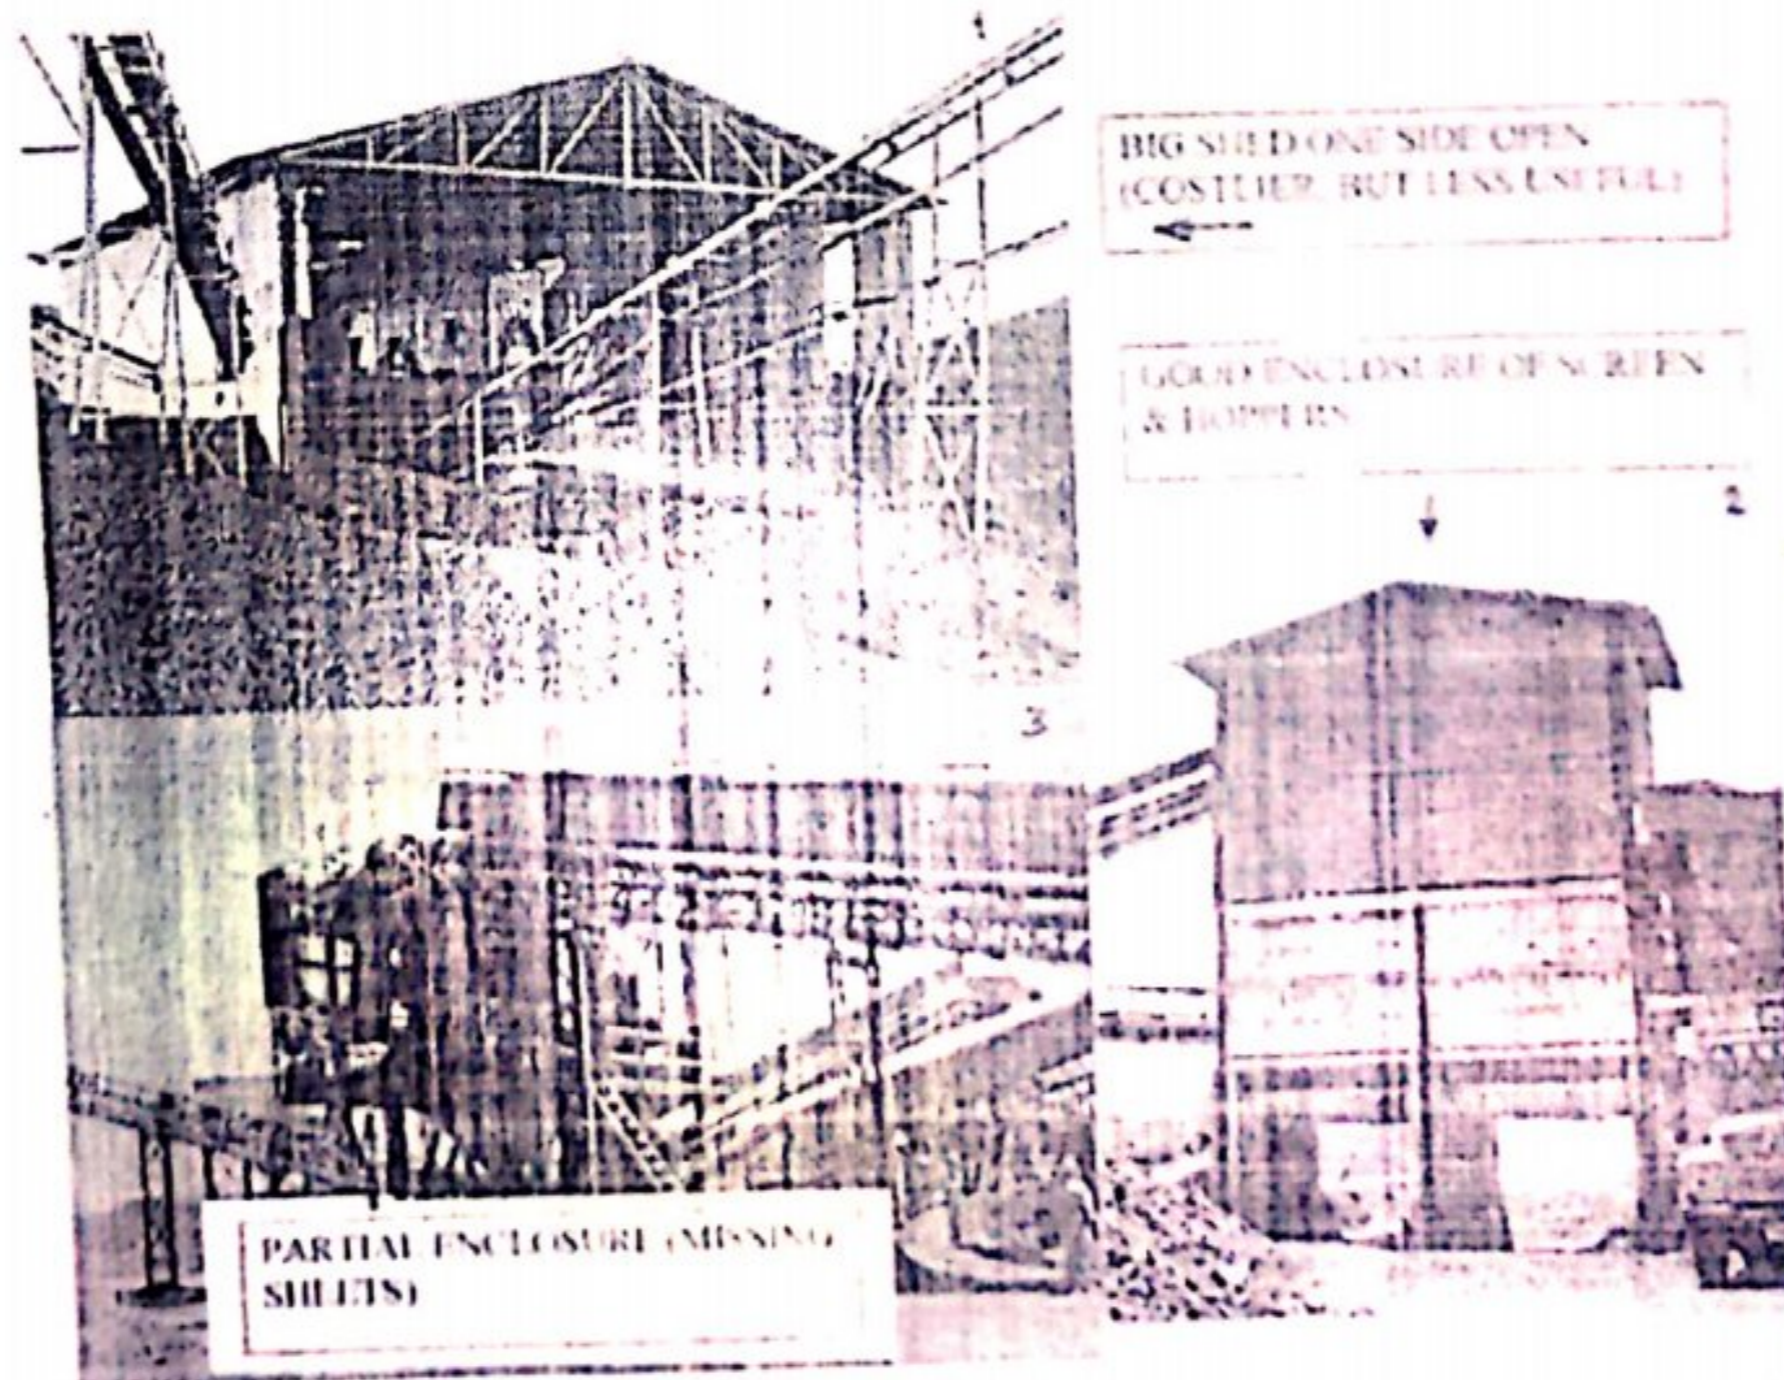

Amll 01/06/2018

- 6. The proponent shall be liable for replacement/up gradation of the Air/Dust Pollution Control System, if the above Air/Dust Pollution Control System failed to bring the dust emission within National Environmental Quality Standards (NEQS), until and unless to bring the dust emission level within National Environmental Quality Standards (NEQS).
- 7. Environmental Management Plan must be strictly followed.



EPA NORTHERN DIRECTORATE, ABBOTTABAD,
Forestry, Environment & Wildlife Department
Govt. of Khyber Pakhtunkhwa



No. EPA/ND/ATD/IEE/CP

Dated: 01/06/2018

8. The proponent shall be liable for correctness and validity of the information supplied by the environmental consultant.
9. The proponent shall be liable for compliance of section 11, 13, 14, 17 and 18 of IEE/EIA Regulations, 2000, regarding approval, written confirmation of compliance, entry, inspection and monitoring.
10. This approval is accorded only for the "CONSTRUCTION PHASE" of project.
11. The proponent will obtain approval for "OPERATION OF THE PROJECT" in accordance with the section 13 (2) (b) and section 18 of the IEE/EIA Regulations, 2000.
12. The proponent will obtain a separate NOC for "MINING ACTIVITIES" from this Agency.
13. The installation site of the crush plant must be 300 meters away from the human settlement.
14. Any change in the approved project shall be communicated to EPA, Northern Directorate, Abbottabad, Khyber Pakhtunkhwa and shall be commenced after obtaining the approval.
15. This approval does not absolve the proponent of the duty to obtain any other approval or clearance that may be required under any law in force.
16. There is no legal pending in the courts against the project.
17. In exercise of the power under Section 14 of the Khyber Pakhtunkhwa Environmental Protection Act, 2014 and The Delegation of Powers Vide letter No. EPA/050/01/93/Peshawar, dated the may 19, 2017, the undersigned is pleased to approve the IEE Report for Yasir Khan Stone Crush plant with the above mentioned terms and conditions.
18. This approval shall be treated as null and void if all or any of the conditions mentioned above is/are not complied with.

Dated: Abbottabad 01/06/2018
Tracking/File. No. EPA/ND/IEE/CP/Yasir Khan/

4621-24

Amir 01/06/2018
DIRECTOR (NORTH)
EPA, NORTHERN DIRECTORATE
HOUSE # CB-136, PMA
KAKUL, ROAD, ABBOTTABAD